


F:\1515001 LDS Billings Herd\15001-P601.DWG Sep 01, 2016 - 6:54am

P L U M B I N G F I X T U R E S C H E D U L E ①							
MARK	FIXTURE	PIPE SIZE					REMARKS
		TRAP	WASTE	VENT	C.W.	H.W.	
CR	CONDENSATE RECEPTOR	1-1/2"	1-1/2"	2"	-	-	SEE DETAIL H/P501, FIELD ASSEMBLED
DF-1	DRINKING FOUNTAIN	1-1/2"	1-1/2"	1-1/2"	1/2"	-	ELECTRIC BI-LEVEL (ADA APPROVED)
FD-1	FLOOR DRAIN	2"	2"	2"	-	-	WITH DEEP SEAL P-TRAP AND TRAP PRIMER. SEE DETAIL C/P502
FD-2	FONT DRAIN	2"	2"	2"	-	-	WITH DEEP SEAL P-TRAP AND TRAP PRIMER. SEE SPECIFICATIONS
FO-1	FONT OVERFLOW	2"	2"	2"	-	-	WITH DEEP SEAL P-TRAP AND TRAP PRIMER. SEE SPECIFICATIONS
FV-1	FONT VALVE	-	-	-	3/4"	3/4"	3/4" SUPPLY OUTLET. SEE DETAIL G/P502
L-1	LAVATORY	1-1/4"	1-1/4"	1-1/2"	1/2"	1/2"	COUNTER TOP ②
L-2	LAVATORY	1-1/4"	1-1/4"	1-1/2"	1/2"	1/2"	SELF SUPPORTING 20"X18", SEE ARCHITECTURAL ELEVATIONS
MV-1	MIXING VALVE	-	-	-	3/4"	3/4"	MOUNT ON WALL AT ACCESS LEVEL. SET DISCHARGE TEMP. AT 110° F. MEETS ASSE 1070.
MV-2	MIXING VALVE	-	-	-	1"	1"	MOUNT ON WALL AT ACCESS LEVEL. SET DISCHARGE TEMP. AT 110° F. MEETS ASSE 1070.
S-1	SERVING AREA SINK	1-1/2"	1-1/2"	1-1/2"	1/2"	1/2"	TWO COMPARTMENT
SS-1	SERVICE SINK	3"	3"	2"	1/2"	1/2"	FLOOR TYPE
SS-2	SACRAMENT SINK	1-1/2"	1-1/2"	1-1/2"	1/2"	-	COUNTER TOP
TP-1	TRAP PRIMER	-	-	-	3/4"	-	5 PORT MANIFOLD. SEE SPECIFICATIONS AND DETAIL C/P502
TP-2	TRAP PRIMER	-	-	-	3/4"	-	10 PORT MANIFOLD. SEE SPECIFICATIONS AND DETAIL C/P502
U-1	URINAL	INT.	3"	2"	3/4"	-	FLUSH VALVE, WALL HUNG, HEU (HIGH EFFICIENCY URINAL)
WC-1	WATER CLOSET	INT.	4"	2"	1/2"	-	FLUSH TANK, HET (HIGH EFFICIENCY TOILET)
WC-2	WATER CLOSET	INT.	4"	2"	1/2"	-	FLUSH TANK, 18" RIM HEIGHT (ADA APPROVED), HET
WC-3	WATER CLOSET	INT.	4"	2"	1/2"	-	FLUSH TANK, 18" RIM HEIGHT (ADA APPROVED), (1.6 GAL. PER FLUSH)
WH-1	WATER HEATER	-	-	-	3/4"	3/4"	ELECTRIC, 1.5 KW, 110V, 1 PHASE, 19-20 GALLON CAPACITY.
WH-2	WATER HEATER	-	-	-	1"	1"	GAS FIRED, 199,000 BTU INPUT. SET DISCHARGE AT 110°F. DIRECT VENT; INSTANTANEOUS TYPE SEE SPECIFICATIONS.

- ① COLD WATER FIXTURE UNITS ARE 99.
WASTE WATER FIXTURE UNITS ARE 110.
- ② WHEN MOUNTED PER ARCHITECTURAL ELEVATIONS, ADA ACCESSIBILITY REQUIREMENTS ARE SATISFIED.

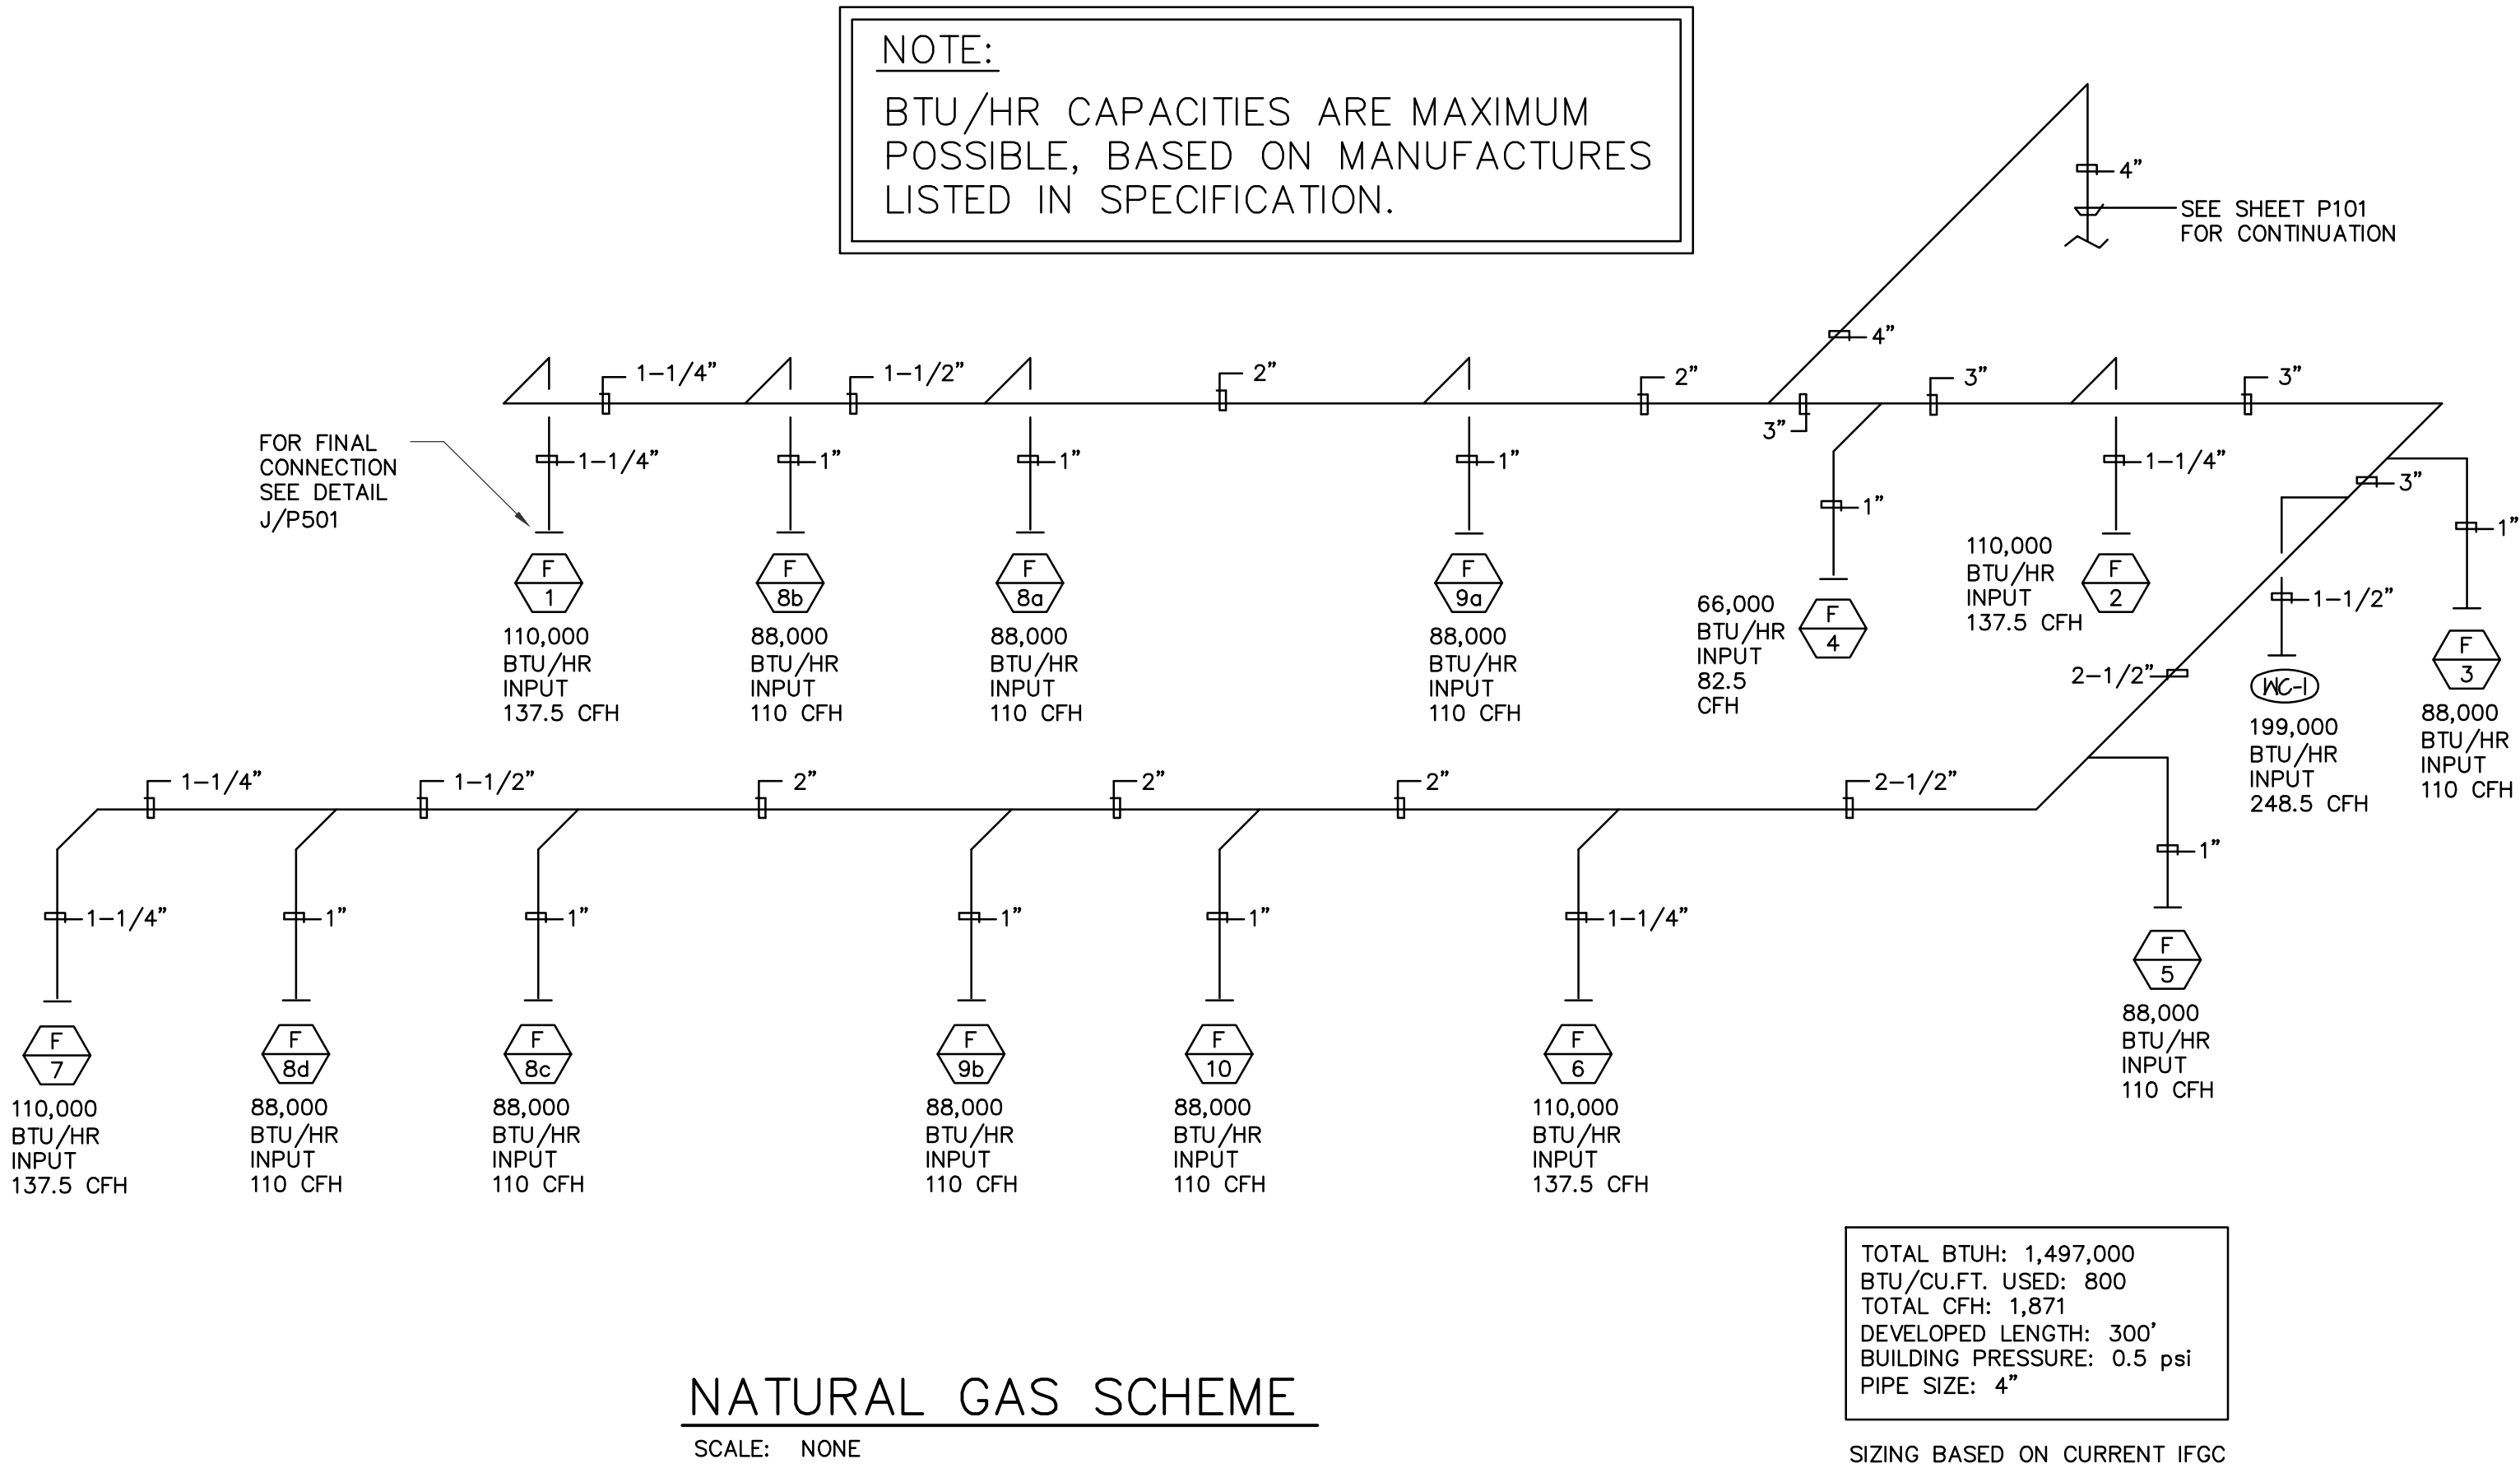

ORIGINAL DRAWING SIGNED BY: DWAYNE C. SUDWEEKS
DATE ORIGINAL SIGNED: Sep 01, 2016
ORIGINAL ON FILE AT ENGINEERED SYSTEMS ASSOCIATES
1355 EAST CENTER, POCAATELLO, IDAHO 83201

Engineered Systems Associates
1355 EAST CENTER
POCAATELLO, IDAHO 83201
PHONE: (208) 233-0501
FAX: (208) 233-0529
EMAIL: eso@engsystems.com
ESA JOB NUMBER: 15001

nbwarchitects p.a.
ARCHITECTURE / PLANNING / INTERIORS
SCOTT L. NELSON, AIA, KEVIN R. BOOBY, AIA, JAMES H. WYATT, AIA
900 JOHN BOHNS PARKWAY, P.O. BOX 2217 - IDAHO FALLS, IDAHO 83402-2212
(208) 322-8175 (F) 208-322-8765 (M) www.nbwarchitects.com

Stamp:

Billings Sweet Grass Creek
Heritage 98
Billings Montana Stake

2620 54th Street W.
Billings Montana 59106

Project for:

THE CHURCH OF JESUS CHRIST OF LATTER-DAY SAINTS

Mark	Date (m.d.y)	Description

Project Number:
15047
Plan Series:
HER-TRA-98-20
Property Number:
501-1850

Sheet Title:
PLUMBING
SCHEDULE AND
GAS PIPING
SCHEME

Sheet:

P601